


**PLAN**  
**SIDEWALK ADJACENT TO CURB**

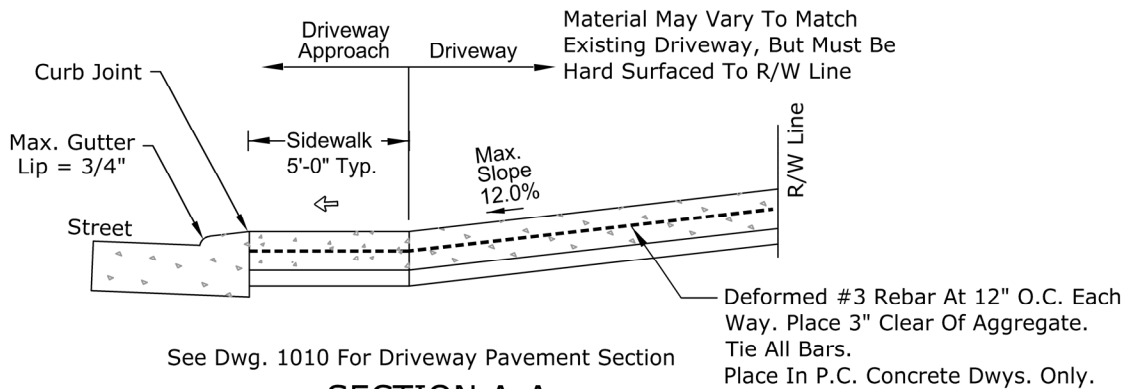

See Dwg. 1010 For Driveway Pavement Section

**SECTION A-A**

Not to Scale

**NOTES: COMMERCIAL DRIVEWAYS**

**LEGEND:**

- ↔ Slope 1.5% Max Design  
Slope 2% Max Finish Grade
- ↔ Slope 7.5% Max Design  
Slope 8.3 Max Finish Grade  
See Note 6

- 1) Use Oregon Commercial Grade Concrete Per Section 00440.
- 2) Trowel Curb Joints With A Minimum 1/4" Radius Along Back Of Curb.
- 3) Place 3/8" Premolded Asphalt Impregnated Material Or Equal. Expansion Joints Extend From Subgrade To Finish Grade. Provide At Cold Joints, End Of Driveways And Each Side Of Inlet Structures.
- 4) Space Contraction Joints At A Max. Of 10'.
- 5) Design Slopes May Be Exceeded To Fit Existing Conditions, Not to Exceed Finish Grade Slope.
- 6) Slope May Be Exceeded If Ramp Length Is 15'.



**WASHINGTON COUNTY**  
DEPARTMENT OF LAND USE &  
TRANSPORTATION  
ENGINEERING SECTION

**COMMERCIAL DRIVEWAY APPROACH  
(CURBTIGHT SIDEWALK)**

PLOT STAMP: 06/01/22 4:42P ANTHONYD  
CAD: 1050.DWG

EFFECTIVE DATE: **06/01/2022**

WASH. CO. #

**1050**