


**PLAN  
SIDEWALK ADJACENT TO CURB**

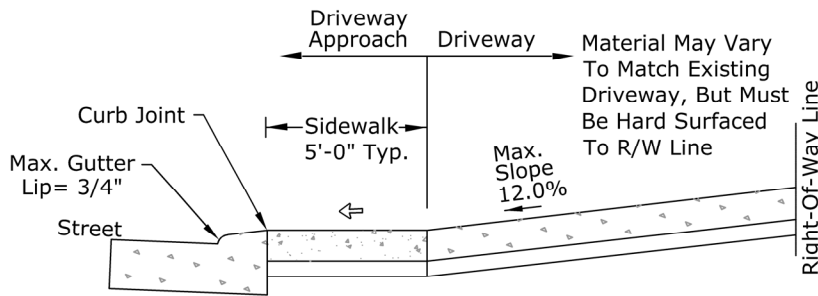

See Dwg. 1010 For Driveway Pavement Section

**LEGEND:**

- ↔ Slope 1.5% Max Design  
Slope 2% Max Finish Grade
- ↔ Slope 7.5% Max Design  
Slope 8.3 Max Finish Grade  
See Note 6

**SECTION A-A**

Not to Scale

DRIVEWAY WIDTH TABLE		
LOT FRONTAGE WIDTH	MINIMUM DRIVEWAY WIDTH	MAXIMUM DRIVEWAY WIDTH
Up To 50 Feet	10 Feet	24 Feet
From 51 Feet To 60 Feet	10 Feet	24 Feet + 1 Foot Per Foot Of Lot Frontage In Excess Of 50 Feet
Greater Than 60 Feet	10 Feet	35 Feet

**NOTES: RESIDENTIAL DRIVEWAYS**

- 1) Use Oregon Commercial Grade Concrete Per Section 00440.
- 2) Trowel Curb Joints With A Minimum 1/4" Radius Along Back Of Curb.
- 3) Place 3/8" Premolded Asphalt Impregnated Material Or Equal. Expansion Joints Extend From Subgrade To Finish Grade. Provide At Cold Joints, End Of Driveways And Each Side Of Inlet Structures.
- 4) Space Contraction Joints At A Max. Of 10'.
- 5) Design Slopes May Be Exceeded To Fit Existing Conditions, Not to Exceed Finish Grade Slope.
- 6) Slope May Be Exceeded If Ramp Length Is 15'.



**WASHINGTON COUNTY**  
DEPARTMENT OF LAND USE &  
TRANSPORTATION  
ENGINEERING SECTION

**RESIDENTIAL  
DRIVEWAY APPROACH  
(CURBTIGHT SIDEWALK)**

PLOT STAMP: 06/01/22 4:39P ANTHONYD  
CAD: 1030.DWG

EFFECTIVE DATE: **06/01/2022**

WASH. CO. #

**1030**